

Scale: 1" = 50'
50 100
SCALE IN FEET


DATE	REVISION
1	2
3	4
5	6
7	8

FARNER BARLEY
AND ASSOCIATES, INC.
350 North Sinclair Avenue, O'Tooles, Florida 32778 O (352) 343-8481
State of Florida, Certificate of Authorization Number: A709

LEGENDS PHASE III MASTER REUSE PLAN

CHECKED BY:
PROJECT NO.: 961504.052
DATE: JAN. 2002
DRAWN BY: SPH
Sht. 18

FILE NAME: LEG(BASE)PH3

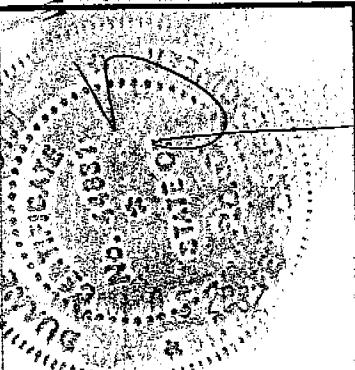

RECEIVED
MAR 07 2002

PDS

ALTAMONTE SVC. CTR.

NOTES:

- All reuse pressure lines shall be pressure tested at 150 psi for twenty-four (24) hours.
- All reuse main crossings under pavement shall be D.I.P.
- All D.I.P. pressure mains and sleeving under roadways shall be extended 5' beyond the back of curb.

LEGEND	
—	REUSE MAIN W/ SIZE NOTE
■	GATE VALVE
■	REDUCER
—	TEE
—	ELBOW
—	SINGLE WATER SERVICE
—	DOUBLE WATER SERVICE

